

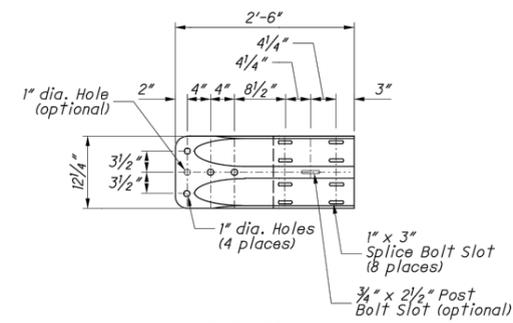
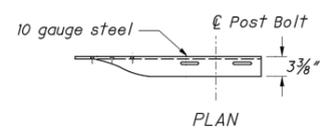




ELEVATION  
W-BEAM FLARED END SECTION

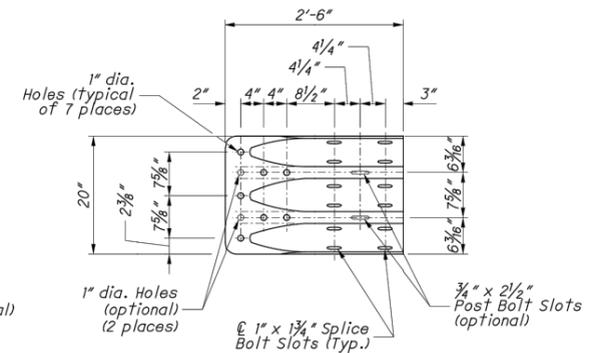



ELEVATION  
W-BEAM TERMINAL CONNECTOR

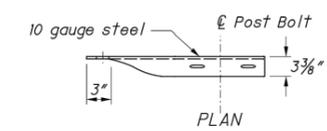


ELEVATION  
THRIE-BEAM TERMINAL CONNECTOR

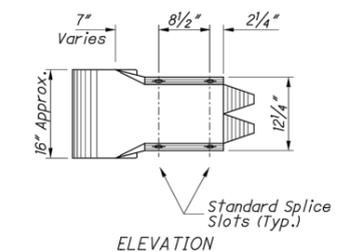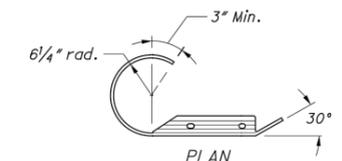


ELEVATION  
ROUNDED W-BEAM END SECTION

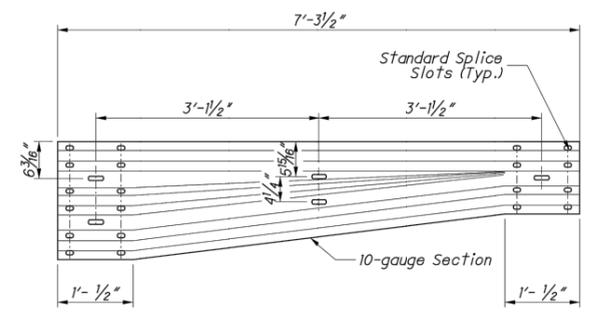

ELEVATION  
ASYMMETRIC TRANSITION SECTION  
(W to Thrie-Beam)

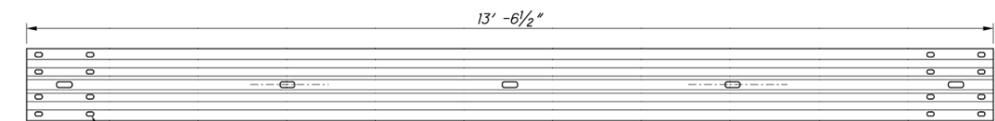

ELEVATION  
12'-6" W-BEAM SECTION

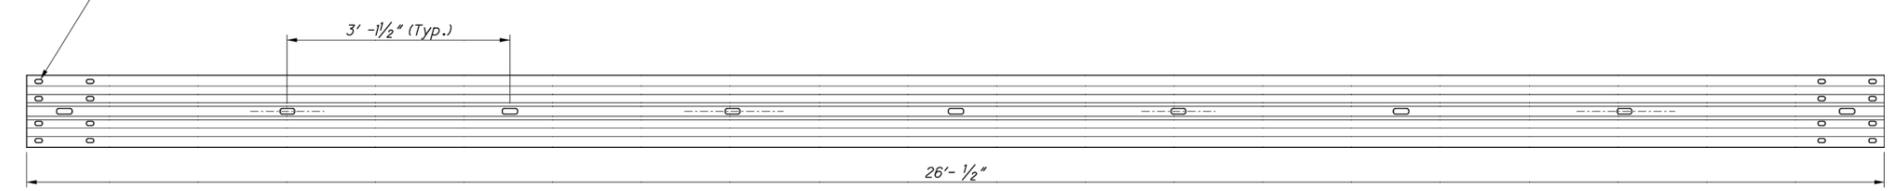

ELEVATION  
25'-0" W-BEAM SECTION

**NOTES**

**GENERAL:** Components shown on this drawing are used in a variety of guardrail systems. See individual guardrail drawing for specific applications.

See CMS 606 for guardrail specifications not covered on these drawings.

Refer to AASHTO M 180-12 for dimensional details of W-Beam and Thrie-Beam rail elements, related buffer and end sections, beam splices, post and splice bolts, nuts, and Type 1 W-Beam to Thrie-Beam Transition sections. Beam washers are not to be used. Bolts grade shall be ASTM A307.

**RAIL ELEMENTS:** Unless otherwise specified, W-Beam Rail is 12 gauge steel with an effective length of 12'-6" or 25'-0", with 3/32"x1/4" splice bolt slots, and 3/4" x 2 1/2" post bolt slots on 3'-1 1/2" centers regardless of post spacing. Field punch or drill bolt holes or slots for irregularly spaced posts as specified in CMS 606.04.

Substituting one 10 gauge steel beam element where two nested 12 gauge steel beams are specified is permitted (both W-beam and Thrie-beam).

**RAIL SPLICES:** Lap splices between two rail elements or between a rail and terminal connector in the direction of traffic. Lap the flared end sections in the direction of traffic.

GUARDRAIL BOLT (For Post and Splice Bolts)		
L	T min.	Bolt Use
22" (Standard Rail)	4"	Type MGS: WP/WB, PB
34" (Barrier Rail)		
14"	4"	Type MGS: SP/WB, PB
1 1/4"	1 1/8"	Splice Bolt

WP = Wood Post      WB = Wood Blockout  
SP = Steel Post      PB = Plastic Blockout

Longer Bolt may be needed for round Wood Post larger than 8" dia.

THIS DRAWING REPLACES MGS-1.1 DATED 7-21-2017

STATE OF OHIO DEPARTMENT OF TRANSPORTATION ADMINISTRATOR	REVISION DATE
David L. Holstein	1-19-2018
STATE ENGINEER	
D. Fisher	
OFFICE OF ROADWAY ENGINEERING	
MID WEST GUARDRAIL SYSTEM GUARDRAIL DETAILS (Rail Components)	
SCD NUMBER	
MGS-1.1	
1	3

**CITY OF ALLIANCE**  
**ENGINEERING DEPARTMENT**  
504 E. MAIN ST.  
ALLIANCE, OH 44601  
PHONE: (330) 823-5122 FAX: (330) 829-2236


**GUARDRAIL DETAILS**  
NOT TO SCALE  
ENGSERV1 / E:/ DATA / ENGINEERING DOCUMENTS / STANDARD DRAWINGS / GR-1.DWG

APPROVED BY:  
  
VINCENT MUESER, P.E., S.I.T.  
ALLIANCE CITY ENGINEER


**ALLIANCE GR-1**  
**(1 OF 3)**

Revisions / Drawn By


02-19-10 / CAF
01-31-22 / ANP

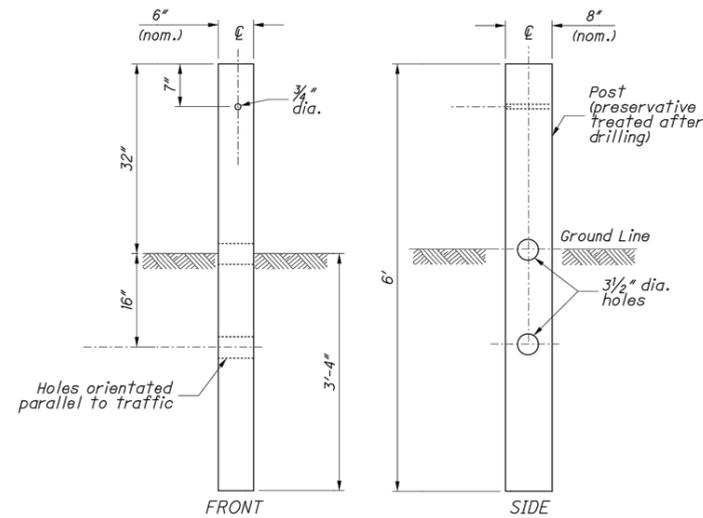

TYPE 1 BREAKAWAY CRT POST

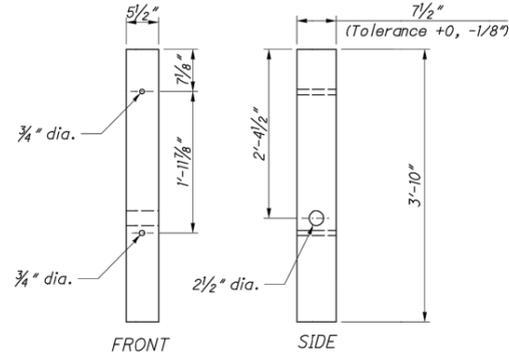


TYPE 2 BREAKAWAY BCT TIMBER POST

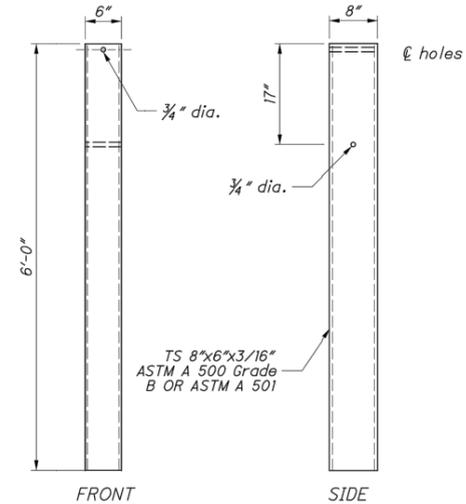


STEEL GROUND FOUNDATION TUBE

STEEL BEAM POSTS				
Size	Beam depth	Flange width	Flange thickness	Web thickness
Rolled W6x8.5	5.8"	3.94"	0.193"	0.170"
Rolled W6x9	5.9"	3.94"	0.215"	0.170"
Welded 6x8.5	6.0"	3.94"	0.193"	0.170"
Welded 6x9	6.0"	3.94"	0.215"	0.170"

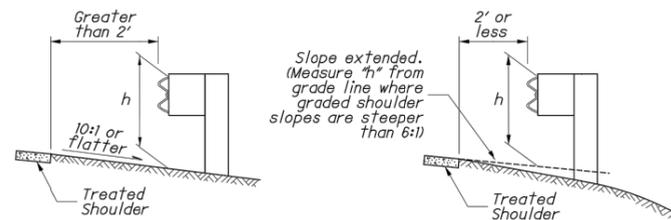

MEASURING GUARDRAIL HEIGHT

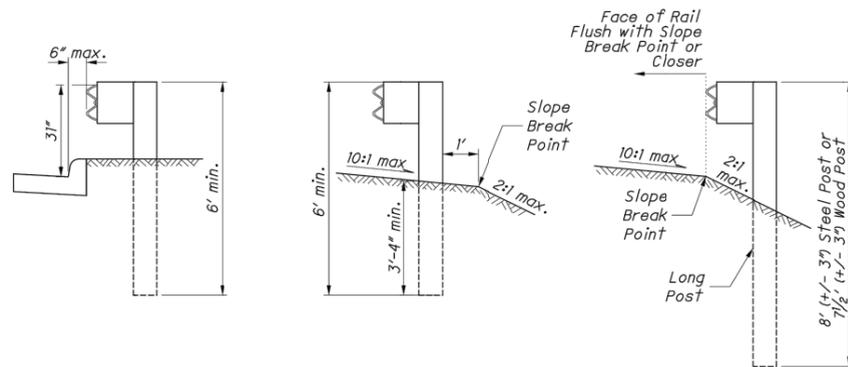

GUARDRAIL POST LENGTH AND POSITION

NOTES

**GUARDRAIL HEIGHT:** For initial installation, construct the guardrail within  $\pm 1"$  of the standard 31" height to the top of W-Beam rail. When subsequent projects, such as resurfacings, affect the height of existing guardrail, adjustment is not required if the finished height is within  $\pm 3"$  of the standard height.

**POSTS:** The Standard Post Length is 6'-0" (+3", -0" tolerance). Wood Posts are permitted instead of Standard Steel Posts per CMS 710.11.



**POST EMBEDMENT DEPTH:** Standard embedment depth is 3'-4" minimum. Embedment depth shall be 37" when using the round wooden post option. Do not drive posts located over a culvert with less than 4'-3" of cover; instead set in drilled or dug holes. Where site constraints prohibit the post from being placed at least one foot in front of the slope break point, use longer posts as shown in the Guardrail Post Length and Position Detail. The face of the rail may not be beyond the slope break point.

**SPECIAL POST MOUNTINGS:** Install posts located over a drainage inlet or structure with a cover of less than 3'-4" as shown in the FOOTING ANCHOR Detail.

**ANCHORS:** Holes shall comply with CMS 510. Use non-shrink, nonmetallic grout per CMS 705.20.

**PROTECTIVE COATING:** In lieu of the complying with CMS 710.06, coat expansion shields, anchors and concrete insert anchor assemblies embedded in concrete in accordance with ASTM A 153 or be of stainless steel. Any bolts screwed into these devices shall meet CMS 710.06.

**PAYMENT:** Payment for standard guardrail is measured in feet as Item 606 - Guardrail, Type MGS. Runs with longer posts should be paid as Item 606 - Guardrail, Type MGS With Long Posts, also measured in feet. All costs associated with special post mountings are included in the unit price bid of Item 606 Guardrail of the type specified in the plans.

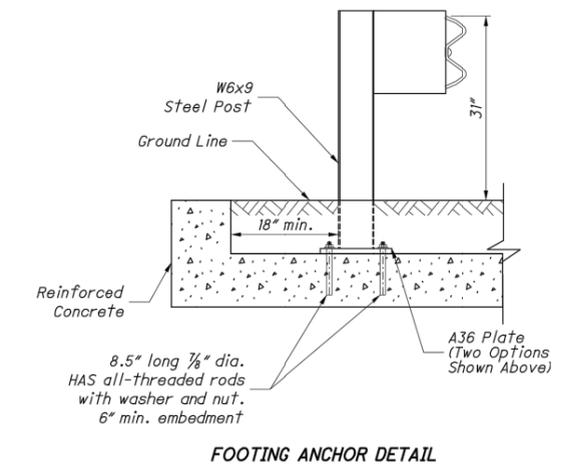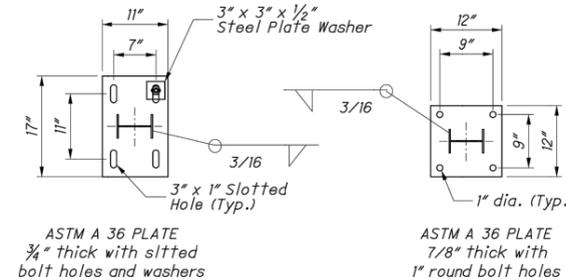

FOOTING ANCHOR DETAIL

THIS DRAWING REPLACES MGS-1.1 DATED 7-21-2017

SCD NUMBER	OFFICE OF ROADWAY ENGINEERING	STATE OF OHIO DEPARTMENT OF TRANSPORTATION ADMINISTRATOR	REVISION DATE
MGS-1.1	D. Fisher	David L. Holstein	1-19-2018



CITY OF ALLIANCE  
ENGINEERING DEPARTMENT

504 E. MAIN ST.  
ALLIANCE, OH 44601  
PHONE: (330) 823-5122 FAX: (330) 829-2236

GUARDRAIL DETAILS

NOT TO SCALE  
ENGSERV1 / E:/ DATA / ENGINEERING DOCUMENTS / STANDARD DRAWINGS / GR-1.DWG





APPROVED BY:

VINCENT MUESER, P.E., S.I.T.  
ALLIANCE CITY ENGINEER

ALLIANCE GR-1  
(2 OF 3)

Revisions / Drawn By

02-19-10 / CAF  
01-31-22 / ANP

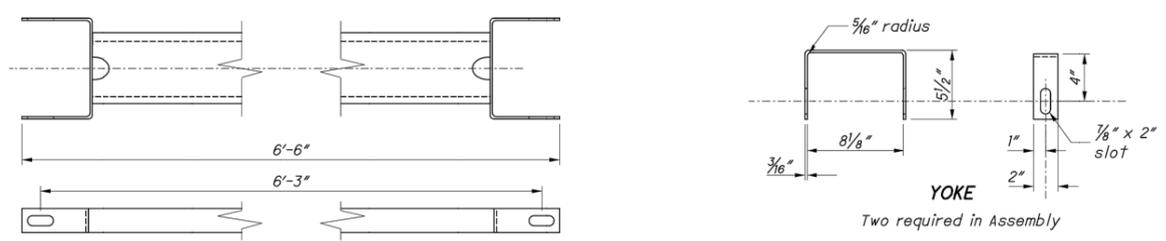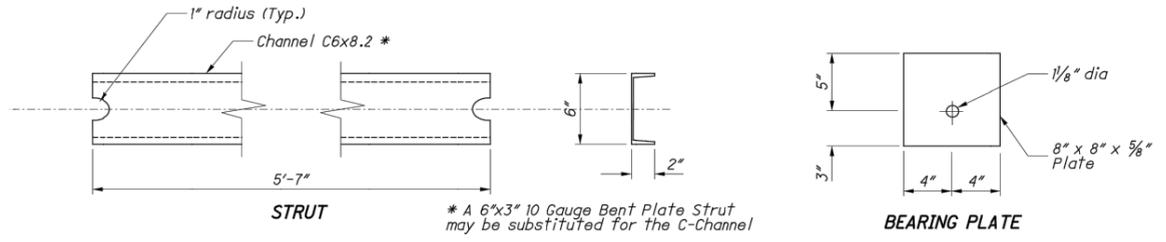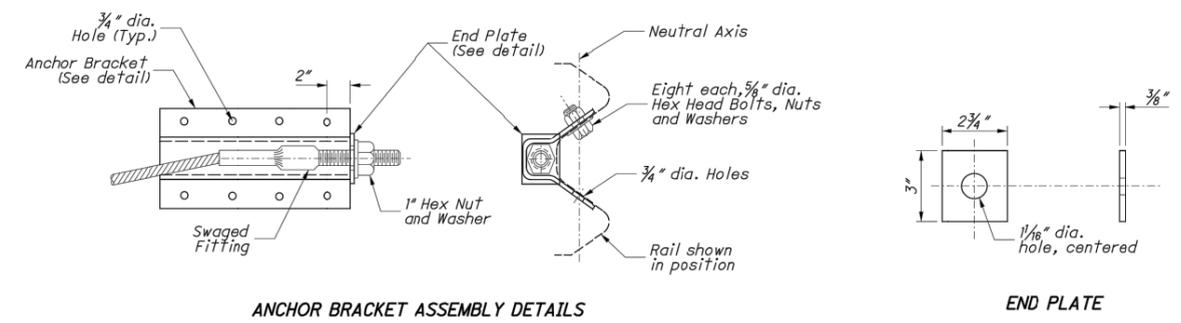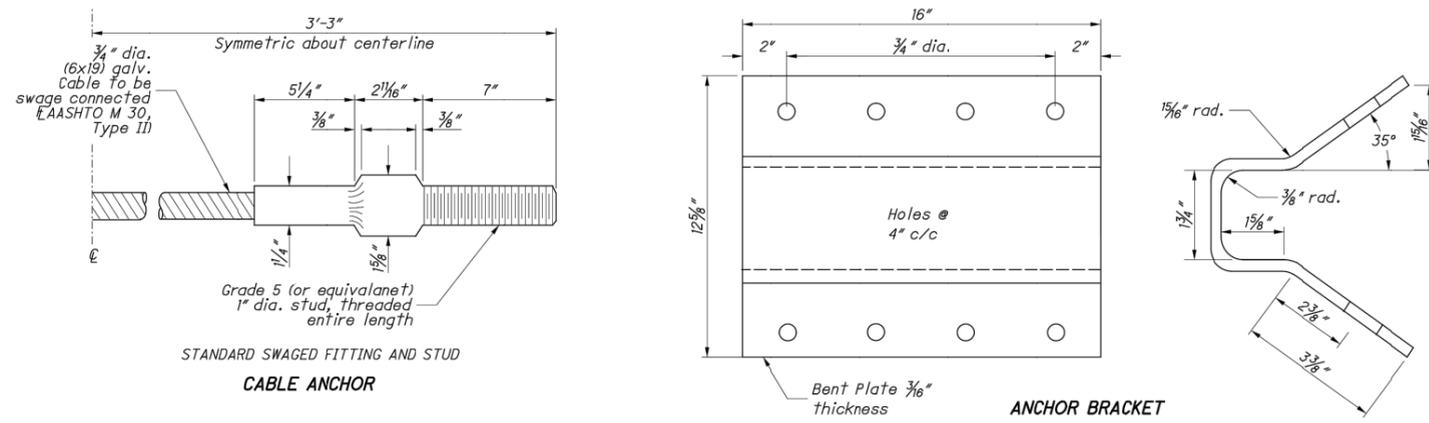

Channel legs shown down. For opposite hand, install Channel legs up.  
**STRUT AND YOKE ASSEMBLY**

THIS DRAWING REPLACES MGS-1.1 DATED 7-21-2017

SCD NUMBER	STATE OF OHIO DEPARTMENT OF TRANSPORTATION ADMINISTRATOR	REVISION DATE
<b>MGS-1.1</b>	David L. Holstein	1-19-2018
STDS. ENGINEER	D. Fisher	
OFFICE OF ROADWAY ENGINEERING		
STANDARD ROADWAY CONSTRUCTION DRAWING		
<b>MID WEST GUARDRAIL SYSTEM GUARDRAIL DETAILS (Rail Components)</b>		
3		3

**CITY OF ALLIANCE**  
**ENGINEERING DEPARTMENT**  
 504 E. MAIN ST.  
 ALLIANCE, OH 44601  
 PHONE: (330) 823-5122 FAX: (330) 829-2236

**GUARDRAIL DETAILS**  
 NOT TO SCALE  
 ENGSERV1 / E:/ DATA / ENGINEERING DOCUMENTS / STANDARD DRAWINGS / GR-1.DWG

APPROVED BY:  
  
 VINCENT MUESER, P.E., S.I.T.  
 ALLIANCE CITY ENGINEER

**ALLIANCE GR-1**  
**(3 OF 3)**

Revisions / Drawn By

02-19-10 / CAF
01-31-22 / ANP